

Sample Name:KRAS G12D Peptide (VVVGADGVGK)

Cat No. : RP30227

Lot No. : E0628224B

Time Processed :6:18:37

Month-Day-Year Processed :02/20/2024

Pump A : 0.065% trifluoroacetic in 100% water (v/v)

Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)

Total Flow:1 ml/min

Wavelength:220 nm

<<LC Time Program>>

Time	Module	Command	Value
0.01	Pumps	B.Conc	5
25.00	Pumps	B.Conc	65
25.01	Pumps	B.Conc	95
27.00	Pumps	B.Conc	95
27.01	Pumps	B.Conc	5
35.00	Pumps	B.Conc	5
35.01	Controller	Stop	

<<Column Performance>>


<Detector A>

Column :Inertsil ODS-SP 4.6 x 250 mm

Equipment: ZJ21010026

<Chromatogram>

mV

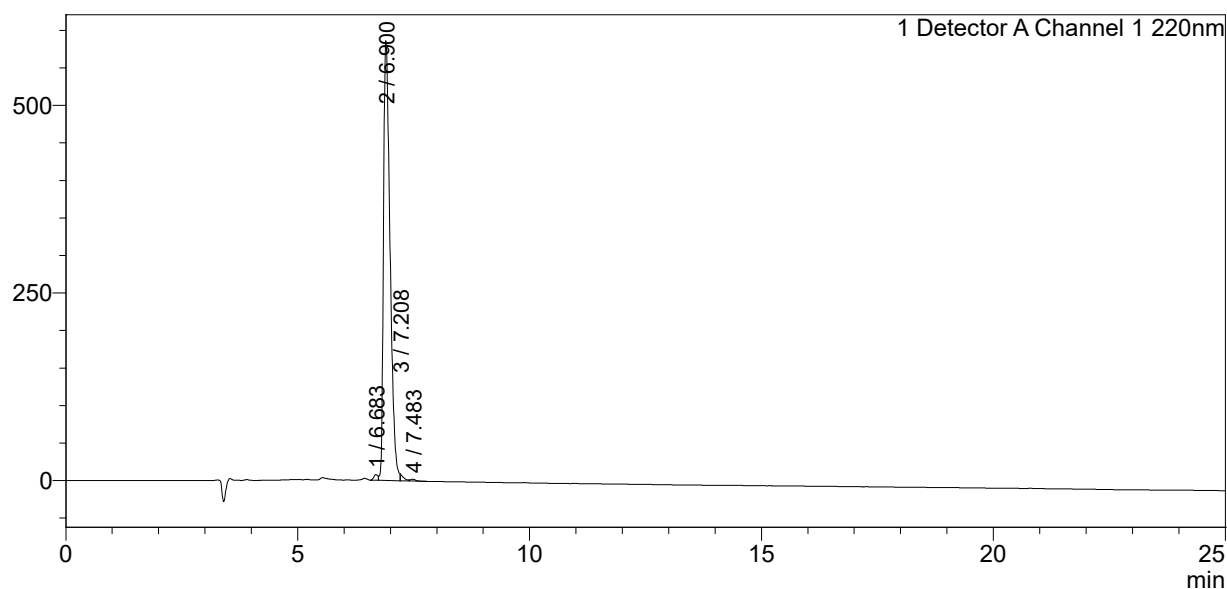

<Peak Table>

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area%
1	6.683	45075	7510	0.765
2	6.900	5784158	586369	98.138
3	7.208	44945	9166	0.763
4	7.483	19749	2480	0.335
Total		5893927	605526	100.000