


Mass Spectrum

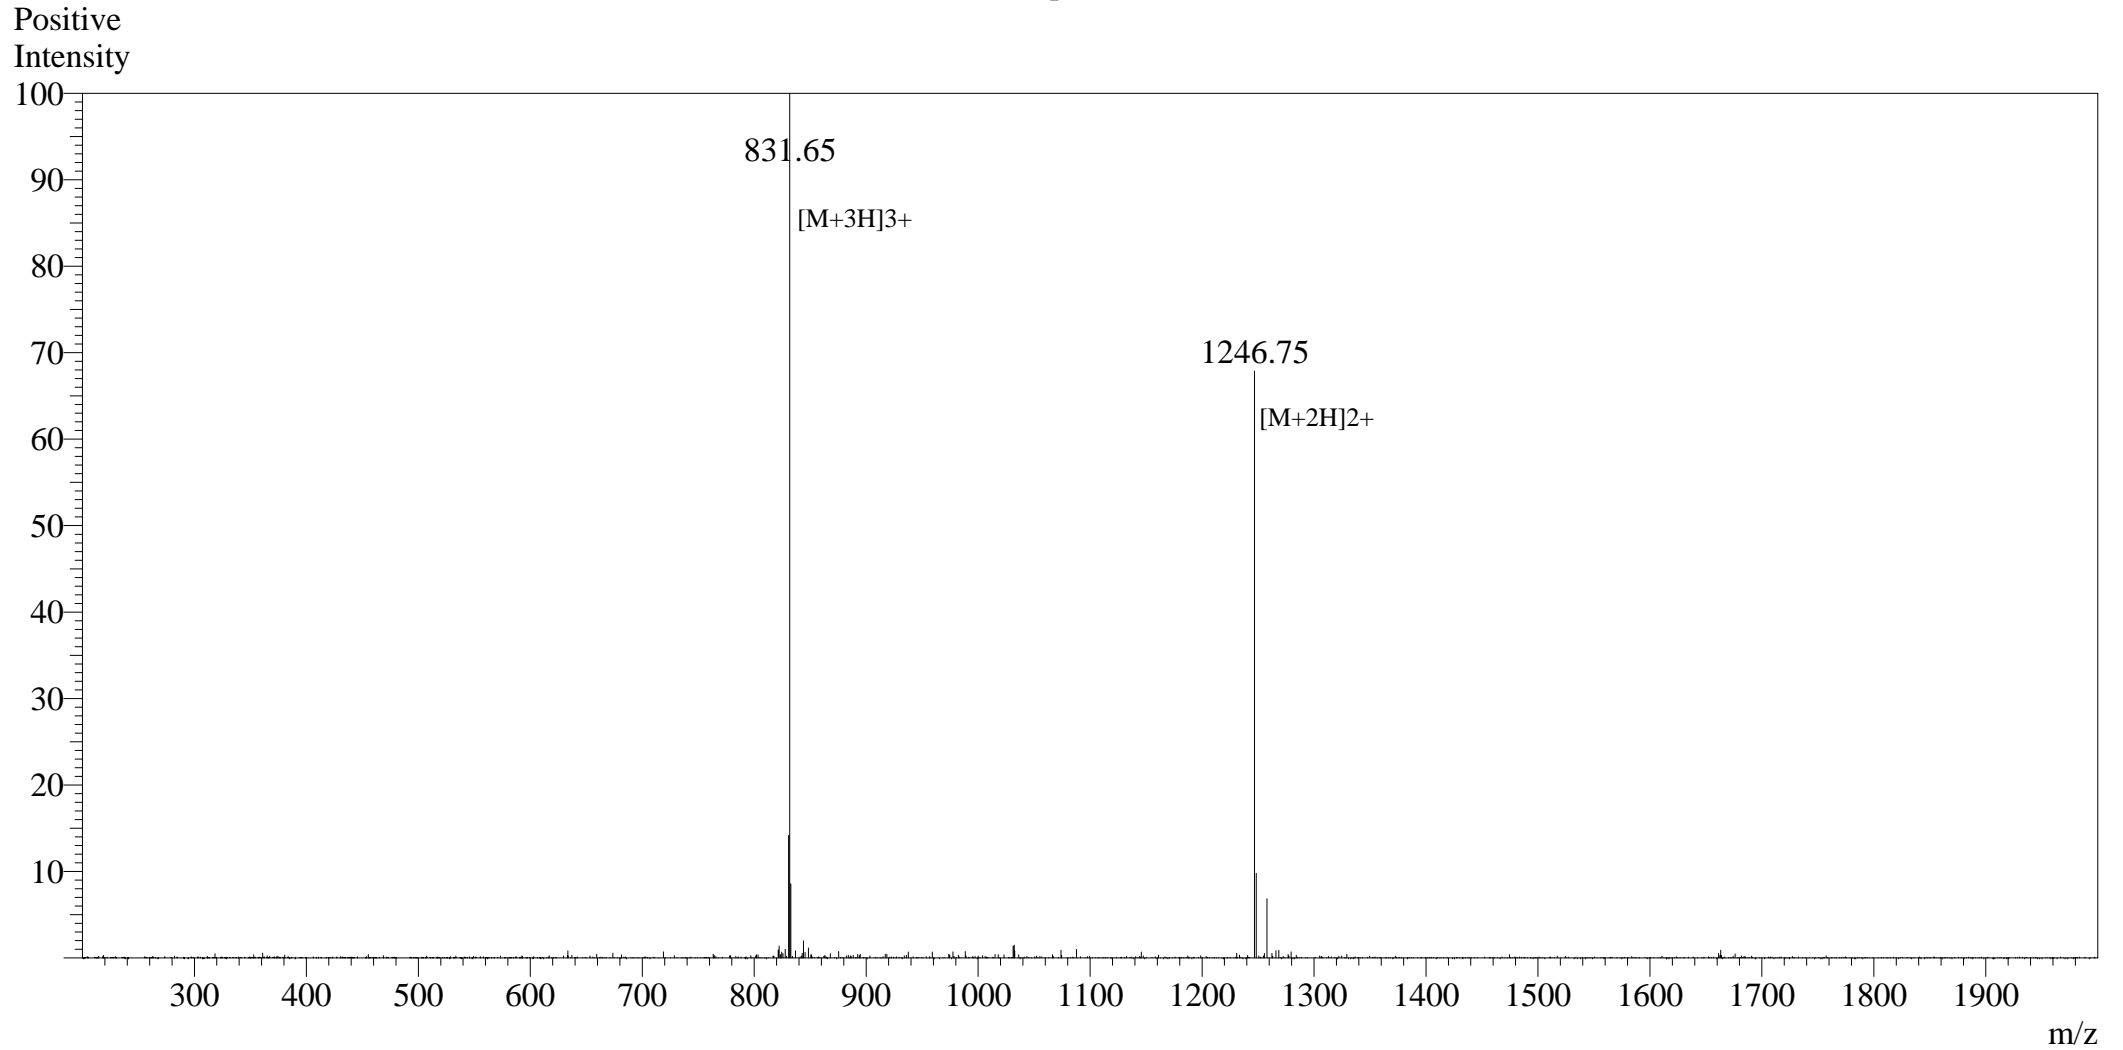

Sample Information

User : Gary
Month-Day Processed : 09/06/14
Time Processed : 19:26:23
Injection Volume : 0.2
Sample Name : Endothelin 1, human, porcine
Cat No. : RP12758
Lot No. : P16161209
Theoretical MW : 2491.90
Observed MW : 2491.95

Interface :ESI
Nebulizing Gas Flow :1.5L/min
CDL Temp :250°C
Block Temp :200°C

Interface Bias :+4.5kV
Drying Gas Flow :5 L/min
T.Flow :0.2ml/min
B.conc :50%H₂O/50%MeOH